


LONG TERM DEVELOPMENT STATEMENT

FOR SOUTHERN ELECTRIC POWER DISTRIBUTION PLC'S ELECTRICITY DISTRIBUTION SYSTEM

November 2024

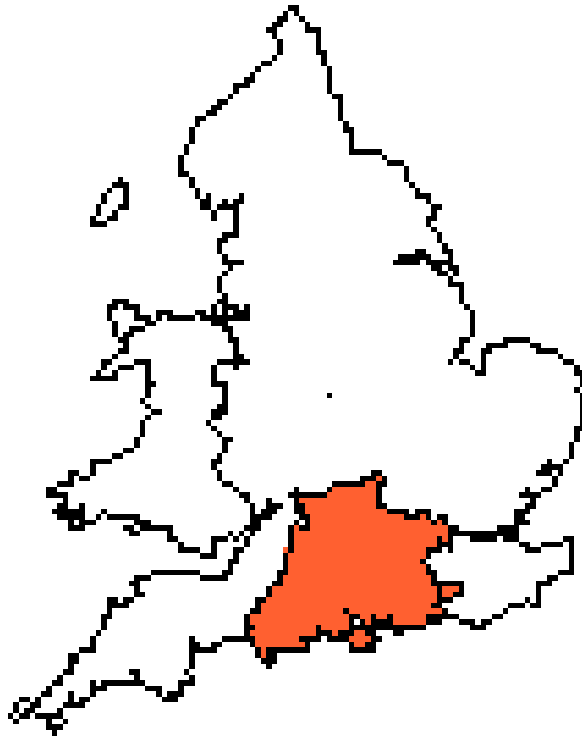

Scottish & Southern
Electricity Networks



SOUTHERN ELECTRIC POWER DISTRIBUTION PLC LONG TERM DEVELOPMENT STATEMENT

FOREWORD

Southern Electric Power Distribution plc (SEPD) is pleased to present this Long Term Development Statement (LTDS) for its electricity distribution network, both In-Area and Out-of-Area¹. It is produced by Southern Electric Power Distribution plc in accordance with its Electricity Distribution Standard Licence Condition (SLC) 25. The statement covers the period 2023/24 to 2028/29.

The main purpose of the LTDS is to assist our existing and prospective users in assessing opportunities available to them for making new or additional use of our distribution system.

The assets referred to in this document are in the ownership of Southern Electric Power Distribution plc. They deliver electricity to over 3 million customers.

Although all reasonable efforts have been made to ensure the accuracy of data, SEPD does not accept any liability for the accuracy of the information contained herein and in particular neither SEPD, nor its directors or employees, shall be under any liability for any errors.

This document may not be reproduced, in whole or part, for any purpose, without the written consent of Southern Electric Power Distribution plc.

¹ Out-of-Area are those SEPD owned networks not within the Southern Electric Power Distribution regional electricity company area.

CONTENTS

INTRODUCTORY Section	4
1 PURPOSE OF STATEMENT	4
2 CONTENTS OF STATEMENT	4
3 CONTACT DETAILS	5
4 OTHER INFORMATION SOURCES.....	7
SUMMARY INFORMATION	8
1 GUIDING PRINCIPLES FOR PLANNING THE DISTRIBUTION SYSTEM.....	9
2 STANDARDS	9
3 DESIGN POLICIES	13
3 NETWORK CHARACTERISTICS	15
4 GEOGRAPHIC AND SCHEMATIC PLANS	23
5 SOURCES OF NETWORK AND CHARGING INFORMATION	24
6 NETWORK INTERFACES	24
DETAILED INFORMATION	26
8 OVERVIEW OF THE SYSTEM	26
9 NETWORK DEVELOPMENT PROPOSALS	28
10 UPCOMING CHANGES TO THE FORM OF THE LTDS	28
10 FURTHER INFORMATION	29
APPENDIX 1	30
APPENDIX 2	32
APPENDIX 3	35

INTRODUCTORY SECTION

1 PURPOSE OF STATEMENT

This Long Term Development Statement (LTDS) is prepared in accordance with the direction given by the Authority (Ofgem) in compliance with paragraph 3 of SLC 25.

The purpose of this statement is to:

- Provide sufficient information which will assist existing and prospective new users who are contemplating entering into distribution arrangements with the licensee, to identify and evaluate opportunities.
- Ensure the general availability of such information in the public domain.
- Inform users of distribution network development proposals.
- Provide users of the correct point of contact for specific enquiries.

Users of the distribution system should also be aware that the main document which governs development and operation of the distribution system is the Distribution Code. This code covers all material technical aspects relating to connections to and the operation and use of the distribution systems of the Licensee.

2 CONTENTS OF STATEMENT

2.1 Summary Information

The Summary Information section provides a brief overview of Southern Electric Power Distribution plc's distribution system in central southern England and its Out-of-Area networks, including high level information relating to the design and operation of all voltage levels of the distribution network.

Small scale geographic plans providing an overview of the 132kV and EHV networks and substations are also provided together with this document on the [SSEN website](#).

The statement contains a range of information associated with our EHV (132kV, 66kV, 33kV and 22kV) distribution system including the HV (11kV and 6.6kV) busbar of primary substations.

More specific information relating to HV and LV systems is available on request. A price list for the provision of this data is included in Appendix 1.

2.2 Detailed Information

The Detailed Information section of the statement gives:

- Information on the guiding principles for planning the distribution system, company internal standards, design policies and network characteristics.
- Schematic and geographical plans showing the EHV system including location of EHV/EHV and EHV/HV substations.
- Details of embedded generation.
- Planned network development proposals for which financial approvals have been given are shown in Appendix 3. They provide a summary of the work to be carried out, timescale and area of the network impacted by each proposal. These exclude like for like replacement (as this does not change system capability) and system developments for new or existing users.

- Detailed information relating to:
 - Circuit Data, Part 2 Table 1
 - Transformer Data Part 2 Table 2
 - Demand Data Part 2 Table 3
 - Fault Level Data Part 2 Table 4a & 4b
 - Generation Part 2 Table 5
 - Connection Interest Part 2 Table 6

The forecast demand is based on our Distribution Future Energy Scenarios (DFES) projections, specifically the Consumer Transformation (CT) scenario and the contracted jobs. Key factors relevant to the DFES include LCT uptake, geographic economic factors, data derived from local authority development plans and demand forecast from large users with knowledge of major changes in connected load. Any known connections works not included in the DFES are added separately with a relevant diversity factor. Diversity factors are applied to the contracted jobs depending on the voltage level and the requested capacity.

The key assumptions included in the demand forecast are as follows:

- DFES projections are specifically based on the Consumer Transformation (CT) scenario.
- Consistent running arrangement and system configurations are considered. Recorded substation peak demands are normalised to account for abnormal running arrangements or equipment faults to ensure the forecast is consistent to previous years running arrangement.
- Power export from distributed generators (DG) is removed, where possible, from recorded figures to give a true representation of underlying substation demand.
- Individual demand forecast submissions from projected connections works are factored into the forecasts
- Committed new loads and new connections are assumed to materialise in the manner predicted i.e., user timing and usage is assumed to occur as advised/requested by customer.
-

** SHEPD will undertake further assessments to determine whether intervention is required where the calculated planning fault levels, identified in Table 4, exceed 95% of the circuit breaker fault level rating. The additional assessments undertaken by SHEPD include, but are not limited to, site specific protection settings analysis and circuit breaker trip testing.

If further assessments confirm that intervention is required SHEPD will determine the most economic, efficient and cost-effective solution to reduce the overall fault level. Possible mitigation works include, but are not limited to, opening the bus-section circuit breaker, reconfiguring the network, installing fast response automation, and extending circuit breaker trip times.

Details of the 132kV system (regarded as transmission voltage in Scotland) are included in the Electricity Ten Year Statement, which is available on the National Energy System Operator (NESO) website: <https://www.neso.energy/>

3 CONTACT DETAILS

The LTDS is available free of charge by sending an email to: Modelling.Reporting@sse.com

or by making a request through the Southern Electric Power Distribution website:

<https://www.ssen.co.uk/our-services/tools-and-maps/long-term-development-statements-ltlds/>

For further information relating to LTDS, or to provide feedback:

Modelling and Reporting
Southern Electric Power Distribution plc
1 Forbury Place

43 Forbury Road
Reading
RG1 3JH
E-mail: Modelling.Reporting@sse.com

Enquiries relating to new load connections or changes to existing load connections should be addressed to:

Connections and Engineering
Customer Service Centre
Scottish and Southern Electricity Networks
Walton Park, Walton Road
Cosham, Portsmouth
PO6 1UJ
E-mail: connections@sse.com
Tel: 0800 0483516

Enquiries relating to connection of generators should be addressed to:

- a. For enquiries involving greater than 50kW,

Major Connections Contracts (MCC)
Scottish and Southern Electricity Networks
Perth Training Centre
Ruthvenfield Way
Inveralmond Industrial Estate
Perth
PH1 3AF
E-mail: mcc@sse.com
Tel: 035 0724319

- b. For enquiries involving less than 50kW,

Microgeneration Connections South
Scottish and Southern Electricity Networks
Perth Training Centre
Ruthvenfield Way
Inveralmond Industrial Estate
Perth
PH1 3AF
E-mail: south.microgen@sse.com
Tel: 0345 0724319

Enquiries relating to connection of generators should review the decision tree via the Southern Electric Power Distribution website or review the “My Generation” PDF for assistance:

<https://www.ssen.co.uk/GenerationConnectionsHome/> (The generation connection section can be found from the connection home page.) Guides are provided in this link to help you apply for your generator connection. Application forms are available through the Energy Networks Association resource library website:

<https://www.energynetworks.org/industry-hub/resource-library/>

Alternatively, the various types of connection applications can be found here:

<http://www.ssen.co.uk/Offlineconnectionsapplications/>.

Enquiries relating to the provision of copies of the Statement of Charges for "Use of Distribution System" should be addressed to:

Distribution Pricing Team
Scottish and Southern Electricity Networks
Inveralmond House
200 Dunkeld Road
Perth
PH1 3AQ
Email: DistributionPricingTeam@sse.com

Enquiries relating to the provision of copies of the "Statement of Methodology and Charges for Connection to the Distribution System" should be addressed to:

Connections Policy Team
Scottish and Southern Electricity Networks
Inveralmond House
200 Dunkeld Road
Perth
PH1 3AQ
Email: connections.policy@sse.com

The Connection and Use of System charging statements can be viewed on our website. Our Connection charging statements are revised from time to time and our Use of System charging statements are revised at least annually. Revised Use of System charges normally take effect from 1 April of each year. The latest documents can be viewed via the link: <http://www.ssen.co.uk/Library/ChargingStatements/SEPD/>

4 OTHER INFORMATION SOURCES

Distributed Generation Connection Guide

The ENA produces connection guides to help users as an owner or developer of distributed generation to connect distributed generation to the UK's electricity distribution networks.

The guides can be viewed by searching for the guide in the ENA resource library at the link below: <https://www.energynetworks.org/publications/2024-dg-guides-combined>

Guaranteed Standards

All network operators must achieve Ofgem's standards of performance for network connection services and meet strict deadlines. Ofgem recognises that not all jobs are equal, so the deadlines vary from five working days to 65 working days. If a network operator fails to meet a deadline, they must pay compensation.

In accordance with the Electricity (Standards of Performance) Regulations 2015, DNOs are obliged to meet guaranteed standards of performance set by Ofgem, the industry regulator.

These guaranteed standards are laid out in three documents which can be viewed by following the below links:

- The Electricity (Connection Standards of Performance) Regulations 2015:
http://www.legislation.gov.uk/uksi/2015/698/pdfs/uksi_20150698_en.pdf
Part 2 – Services and Standards for Metered Connections
Part 3 – Services and Standards for Unmetered Connections
- The Electricity (Standards of Performance) Regulations 2015:
http://www.legislation.gov.uk/uksi/2015/699/pdfs/uksi_20150699_en.pdf
- The Electricity and Gas (Standards of Performance) (Suppliers) Regulations 2015

Process to Request Additional Network Data

Enquiries relating to the provision of additional network data to that contained in the LTDS should be sent to: Modelling.Reporting@sse.com

SSEN Data Portal

In October 2023, we launched our [Data Portal](#) to drive forward net zero decisions. Our Data Portal is a single point of access to all the data SSEN publishes and a catalogue of data that brings visibility to our network assets, their location, their usage, and their performance.

All documents related to the Scottish Hydro Electric Power Distribution plc (SHEPD) and SEPD LTDS submission are published on our Open Data Portal, along with other planning publications such as the Network Development Plan, DFES, Capacity Heatmaps and Embedded Capacity Register (ECR). The timeline of these documents is shown in the figure below.

SSEN Distribution's commitment to transparency and accessibility is a significant step forward in the transition to a net-zero future, and by providing this vital information, this data portal will play a pivotal role in reducing greenhouse gas emissions, improving energy efficiency, and ultimately taking us all closer to achieving our sustainability goals.

We have built our data portal on CKAN allowing us to display our data in a user-friendly environment and allow our data consumers to use data in a meaningful way. CKAN has been used extensively by our Open Data Peers and Partners and allows us to tailor our portal, to serve our customers.

Link to data portal: [SSEN Data Portal](#).

To understand how to use our portal please view our video guide [here](#).

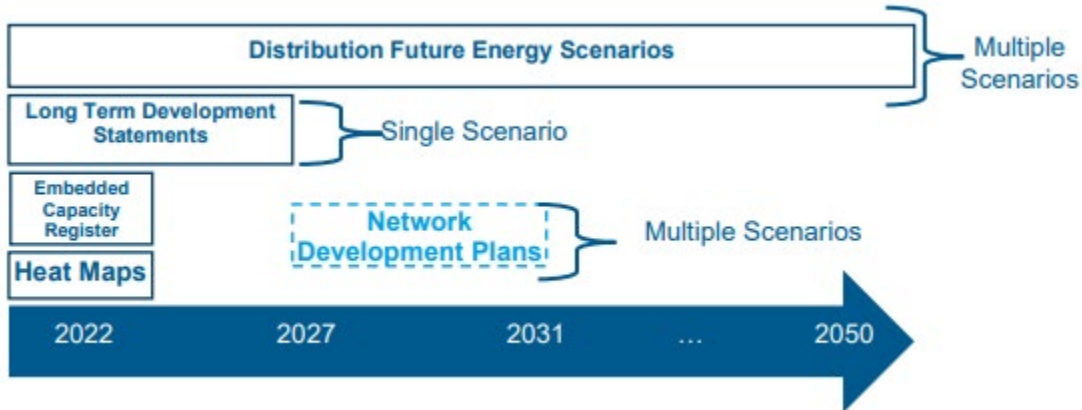


Figure 1 - LTDS in relation to other scenario and capacity reporting by DNOs

SUMMARY INFORMATION

The following information can be obtained by contacting us at Modelling.Reporting@sse.com:

- Details of the substation group and the substation or busbar node names
- Contact point for information requests
- Timescales for providing information
- Cost for providing additional information

Details of the transmission system are included in the Electricity Ten Year Statement, which is available on the National Energy System Operator (NESO) website: <https://www.neso.energy/>

1 GUIDING PRINCIPLES FOR PLANNING THE DISTRIBUTION SYSTEM

The following standards are the guiding principles which underpin the policy for planning and designing the distribution network in Southern Electric Power Distribution plc:

- Licence Conditions
- Distribution Code
- Electricity Safety, Quality and Continuity Regulations
- Environmental Standards
- Company Internal Standards

2 STANDARDS

2.1 Licence Conditions

2.1.1 Pursuant to a licensing scheme made by the Secretary of State, under part II of Schedule 7 to the Utilities Act 2000, Southern Electric Power Distribution plc has been granted a licence under section 6(1) (c) of the Electricity Act 1989 authorising it to distribute electricity for the purpose of giving a supply to any premises in the area specified in Schedule 1 of the Act.

2.1.2 Standard Licence Condition (SLC) 24 - Distribution System planning standard and quality of performance reporting - requires the licensee to plan and develop the distribution system in accordance with a standard not less than that set out in Engineering Recommendation (ER) P2/8. SEPD meets this requirement by having an Ofgem approved planning standard (TG-NET-NPL-012 Distribution Planning – Standards of Voltage and Security of Supply) which sets out how security of supply will be met in its distribution services area.

In accordance with SLC 24 (para 4) the Authority (Office of Gas and Electricity Markets, Ofgem) may, following consultation with the licensee, issue directions relieving the licensee of its obligation under para 1 (as stated in the above paragraph) in respect of the licensee's distribution system and to such extent as may be specified in the directions.

To meet the above standard our policy is to plan networks at the most economic cost. To achieve this, we have taken two approaches:

- For high volume works where point of connection is low voltage (230 and 400 V) or high voltage (11 or 6.6 kV) we have standard connection arrangements which ensure compliance with ER P2/8.
- For lower volume, high cost developments, principally at EHV, i.e. 132, 66, 33 and 22 kV, we will tailor development to meet standards on an individual basis to optimise cost-benefit and customer requirements.

2.1.3 Under SLC 12 - Requirement to Offer Terms for Use of System and Connection - the licensee shall, on application, offer to enter into an agreement (Connection Agreement) for use of system.

Where the licensee makes an offer to enter into a connection agreement, the licensee shall, in making the offer, make detailed provision regarding:

- The carrying out of the works required to connect the licensee's distribution system to any other system for distribution of electricity.

- The carrying out of works in connection with the extension or reinforcement of licensee's distribution system rendered appropriate by reasons of making the connection.
- The installation of appropriate meters required to enable the licensee to measure electricity being accepted into the licensee's distribution system at the specified entry point or leaving such systems at the specified exit point.
- Installation of such switchgear or other apparatus (if any) as may be required for the interruption of supply where the person seeking connection or modification of an existing connection does not require the provision of top-up or standby.
- The charges to be paid in respect of services required. To determine an appropriate proportion of the costs directly or indirectly incurred the licensee shall have regard to the benefit to be obtained or likely in the future to be obtained.

In determining the costs of connection of demand and generation, the licensee shall apply the charging principles set out in the annual charging statements including, where applicable, application of:

- Cost apportionment of any necessary reinforcement for the Connection; and,
- Distributed Generation Incentives.

The statements which set out the basis of charges for "Use of System" and "Connection to the Distribution System" are entitled:

- Statement of charges for use of Southern Electric Power Distribution plc's distribution system;
- Statement of charging methodology for use of Southern Electric Power Distribution plc's distribution system.
- Statement of charging methodology for connection to Southern Electric Power Distribution plc's distribution system.

(All the above as amended from time to time.)

All the above statements are available on our website www.ssen.co.uk or by sending an email to connections@sse.com

2.2 Distribution Code

Under SLC 20 of the Licence the licensee shall prepare and at all times have in force and shall implement and comply with the Distribution Code.

The Distribution Code covers all material technical aspects relating to connections to and the operation and use of the licensee's distribution system or the operation of electric lines and electrical plant connected to the licensee's distribution system.

It requires the licensee's distribution system to be designed so as to permit the development, maintenance and operation of an efficient, co-ordinated and economical system and to facilitate competition in the generation and supply of electricity.

The Distribution Code includes:

- A distribution planning and connection code containing:
 - Connection conditions specifying the technical, design and operational criteria to be complied with by any person connected or seeking connection to the licensee's distribution system; and
 - Planning conditions specifying the technical and design criteria and procedures to be applied by the licensee in the planning and development of the licensee's distribution system and to be taken into account by persons connected or seeking connection with the licensee's distribution system in the planning and development of their own plant and system; and
- A distribution operating code specifying the conditions under which the licensee shall operate the licensee's distribution system and under which persons shall operate their plant and/or distribution systems in relation

to the licensee's distribution system, in so far as necessary to protect the security and quality of supply and safe operation of the licensee's distribution system under both normal and abnormal conditions.

It contains references to the following Electricity Supply Industry publications which provide guidance on planning and design criteria:

Engineering Recommendation G5/5

Planning levels for harmonic voltage distortion and the connection of non-linear equipment to transmission and distribution systems in the United Kingdom.

Engineering Recommendation G12/4

Requirements for the application of protective multiple earthing to low voltage networks.

Engineering Recommendation G99

Requirements for the Connection of generation equipment in parallel with public distribution networks on or after 27 April 2019.

Engineering Recommendation P2/8

Security of Supply.

Engineering Recommendation P14

Preferred switchgear ratings.

Engineering Recommendation P24

AC traction supplies to British Rail.

Engineering Recommendation P25

The short circuit characteristics of electricity boards low voltage distribution networks and the co-ordination of overcurrent protective devices on 230V single phase supplies up to 100A.

Engineering Recommendation P26/1

The estimation of the maximum prospective short circuit current for three phase 415V supplies.

Engineering Recommendation P28

Planning limits for voltage fluctuations caused by industrial, commercial and domestic equipment in the United Kingdom.

Engineering Recommendation P29

Planning limits for voltage unbalance in the United Kingdom for 132kV and below.

Technical Specification 41-24 November 2009

Guidance for the design, installation, testing and maintenance of main earthing systems in substations.

Engineering Recommendation S34

A guide for assessing the rise of earth potential at substation sites.

Engineering Recommendation G98

Requirements for the connection of Fully Type Tested Micro-generators (up to and including 16A per phase) in parallel with public Low Voltage Distribution Networks on or after 27 April 2019

Engineering Recommendation G81

Framework for design and planning, materials specification and installation and record for Greenfield low voltage housing estate installations and associated, new, HV/LV distribution substations.

(Related SEPD specifications are detailed on our website.)

<https://www.ssen.co.uk/connections/usefuldocuments/>

DTI Publication - Technical Guide to Connection of Embedded Generators to the Distribution Network (KEL 000318).

See Section 7 for enquiries relating to the Distribution Code.

2.3 Electricity Safety, Quality and Continuity Regulations

The Secretary of State issued The Electricity Safety, Quality and Continuity Regulations in 2002 to:

- Ensure that the electricity supplies are regular and efficient.
- Protect the public from dangers arising from distribution of electricity, use of electricity supplied or from installation, maintenance or use of any electricity line or electrical plant.
- Eliminate or reduce the risks of personal injury or damage to property or interference with its use.

Regulation 27 gives permitted variations at all low voltage customers' terminals of +10% and -6% of the declared voltage of 230V single phase or 400V three phase. For higher voltages below 132kV the permitted variations are between +6% and -6% of the declared voltage, and at 132kV or above they are between +10% and -10% of the declared voltage. It is therefore necessary to hold the system voltage within these ranges on all systems to which customers are connected, i.e. all low voltage systems, most HV systems and some EHV systems.

2.4 Environmental Standards

Schedule 9 of the Electricity Act 1989 requires SEPD to consider the effect of its work on the amenity and fisheries and to mitigate the effects where reasonable.

In planning, designing and operating the distribution system our policy is to pay due regard to environmental matters and, in particular, noise, visual amenity and pollution. We seek Planning Authority and Department of Trade and Industry approval to build new lines. We also endeavour to meet the requirements of other bodies, such as Natural England and the Environmental Agency, in protected areas such as Areas of Outstanding Natural Beauty. We will seek to avoid disturbance or detriment to such areas as far as reasonably practicable consistent with the economic and reliability impact on our distribution network and on customers' costs.

2.5 Company Internal Standards

In addition to meeting the above standards, SEPD has internal standards to improve quality of supply and reduce duration of supply interruptions.

2.5.1 General

The targets for duration of supply interruption, customer minutes lost (CMLs) per customer per year, and number of customer interruptions (CIs) are agreed with Ofgem. These standards are in addition to the Guaranteed Standards set by Ofgem.

In planning, designing and operating the distribution system the systematic use of automation, mobile generation and targeted investment for refurbishment of the distribution system is designed to deliver these targets.

To meet the individual needs of customers, we will agree standards of connection whether in excess or lower than the appropriate levels as stated in the relevant network standard. In these cases, we will agree special commercial terms.

2.5.2 Capacity Planning

To ensure that the distribution system has adequate capacity to meet system demand, voltage and current flows are regularly monitored and adequacy of the network is checked. Capacity is benchmarked to estimated loads. Where there is a shortfall in network capacity we will seek appropriate solutions. These will usually involve network reinforcement but could involve alternative solutions.

2.5.3 System Voltage Control

The total full load volt drop for the transfer of power from the high voltage distribution system to the low voltage supply system is approximately 30%. Therefore, voltage correction must be applied in the appropriate places to comply with Regulation 27 of the Electricity Safety, Quality and Continuity Regulations 2002. This is carried out as follows:

- In higher voltage system by:
 - Control of reactive power flows. This includes switching in or out lightly loaded circuits, shunt capacitors and reactors, use of synchronous compensators, operation of "tap-stagger" and use of voltage above or below nominal.
 - Auto/manually controlled on-load tap changers on 400/132kV and 275/132 kV transformers).
 - Central control by despatch of reactive power from synchronous generators.
 - Automatic voltage control on synchronous generators.
- In the lower voltage systems by:
 - Automatically controlled on-load tap changers fitted to 132/33 kV and 33/11 kV transformers;
 - Line drop compensation on most 11kV systems;
 - Reactive compensation (shunt reactors and capacitors);
 - Off load tap changers fitted to 33 kV/LV and 11 kV/LV transformers;
 - Voltage regulators on the LV system.

3 DESIGN POLICIES

3.1 General


When planning and designing an electricity distribution system it is necessary to consider all alternative options to achieve an optimum solution based on technical and economic considerations.

The Company's distribution system has been standardised at 132kV, 66kV, 33kV and 22kV (called EHV), 11kV and 6.6kV (called HV) and 230/400 V (called LV).

The forecast demand is based on our Distribution Future Energy Scenarios (DFES) projections, specifically the Consumer Transformation (CT) scenario and the contracted jobs. The DFES projections and contracted jobs for 2023/24 are shown alongside the actual recorded values for a direct comparison. DFES projections for the next 5 years are shown where available, otherwise the forecast is based on the historical growth trend plus any large known developments. Diversity factors are applied to the contracted jobs depending on the voltage level and the requested capacity.

The key assumptions included in the demand forecast are as follows:

- The average cold spell (ACS) forecast assumed system peak demand is adjusted so the annual forecast references to a common temperature base. A weighted average temperature, where ambient temperature is considered over a three-day period, is used in the calculation and appropriate adjustments are made to demand readings to produce the ACS values, which is what the demand would have been if the ambient temperature had been 0° C.
- Consistent running arrangement and system configurations are considered. Recorded substation peak demands are normalised to account for abnormal running arrangement to ensure the forecast is consistent with previous years running arrangement.
- Individual demand forecast submissions from large consumers are factored into forecasts.
- Committed new loads and new connections are assumed to materialise in the manner predicted i.e. user timing and usage is assumed to occur as advised/requested by customer.



SEPD will undertake further assessments to determine whether intervention is required where the calculated planning fault levels, identified in Table 4, exceed 95% of the circuit breaker fault level rating. The additional assessments undertaken by SEPD include, but are not limited to, site specific protection settings analysis and circuit breaker trip testing.

If further assessments confirm that intervention is required SEPD will determine the most economic, efficient and cost-effective solution to reduce the overall fault level. Possible mitigation works include, but are not limited to, opening the bus-section circuit breaker, reconfiguring the network, installing fast response automation and extending circuit breaker trip times.

Fault level information is published for planning purposes only. It should not be used for operational purposes and does not necessarily reflect current operational circumstances.

3.2 132 and 33 kV System Design

132kV and 33kV networks from 400/132 kV and 132/33 kV substations (or equivalent 66kV and 22kV networks) normally run either radially or as open or closed rings. However, some networks run in parallel with those from other sources where technically acceptable and economically advantageous.

Additions to or reinforcements of these networks are considered individually and tailored to the existing network arrangements. The most economic investment is determined in line with any long-term proposals and having regard to network complexity, operational requirements and flexibility.

Studies are completed to ensure acceptable voltage conditions, compliance with security of supply standards for first and second circuit outages in accordance with Engineering Recommendation P2/8 and that circuit and plant ratings are not exceeded.

Additionally, for generation, studies are completed to identify any locations where increased fault currents exceed switchgear ratings. For larger sets, or where there is likely to be interaction with existing customers with large motor drives, steady state and transient stability studies are needed to:

- Ensure generation and the networks remain stable following circuit switching or a network fault.
- Check interaction with other nearby generation.
- Predict any possible loss of synchronism and the corresponding need for additional protection to avoid damage to the generator or unacceptable voltage or power swings.

3.3 Supplies from Primary (typically 33/11 kV) Substation

The maximum number of 11kV circuits from a 33/11 kV substation is determined based on network configuration and maximum utilisation, e.g. for a substation with 2 x 15/30 MVA transformer capacity, the normal maximum number of 11kV feeders would be 8.

Interconnecting feeders, where practical, would emanate from separate sections of busbar consistent with minimising initial switchgear requirements and allowing for future extensions.

New feeders will be controlled by automatic circuit breakers of 630A nominal load rating.

3.4 HV Network Configurations

The HV network is normally configured to achieve maximum utilisation whilst maintaining security of supply standards at a minimum cost.

The HV urban network is normally configured as a "loop-tee-loop" arrangement in an open "ring" formation. However, where an individual customer requires more or less security of supply standard, then the connection to that customer will be designed to meet specific needs.

The HV rural network is normally configured as an open "ring" with pole mounted HV/LV transformers directly connected. However, where group demand is below 1MVA the network configuration may be radial feed with no backfeed facility. Furthermore, there may be lengthy spurs (single and three phase), in particularly remote locations, served by overhead line circuits.

3.5 Low Voltage Network Configuration

The feeding arrangement on the low voltage network is normally radial with no interconnection. There is existing interconnected LV network which operates as radial and is configured as an "open" ring. The layout of distributors is optimised in relation to services to be supplied. Distributors are normally laid in footways.

3 NETWORK CHARACTERISTICS

4.1 Standard Plant and Equipment sizes

Various types of plant and equipment exist on the EHV and HV systems. Typical details are given below.

4.1.1 132 and 66 kV System

- Bulk Supply Point Transformers
 - **Voltage Ratio** **132/33 kV**
 Vector Group YD1, YD11
 Rating 90, 60, 45, 30 MVA
 Tapping Range -10% to +20% and -10% to +10% (on load)
 - **Voltage Ratio** **132/22 kV**
 Vector Group YD1
 Rating 60, 45 MVA
 Tapping Range -10% to +20% and -10% to +10% (on load)
 - **Voltage Ratio** **132/11 kV**
 Vector Group YD1, YD11, YY1, YY11
 Rating 45, 30, 20, 15 MVA
 Tapping Range -10% to +20% and -10% to +10% (on load)
 - **Voltage Ratio** **66/22 and 66/11 kV**
 Vector Group YY6
 Rating 60, 40, 30, 20 MVA
 Tapping Range -10% to +20% and -5% to +15% (on load)
- Switchgear
 - **132kV CBs**
 Current Rating 800, 1200, 2000, 3150 Amps
 Fault rating 18.4, 25, 31.5, 40 kA
 - **66kV CBs**
 Current Rating 800, 1200, 2000, 3150 Amps
 Fault rating 21.9, 25.0, 40 kA

4.1.2 33 and 22 kV System

- Primary Transformers
 - **Voltage Ratio** **33/11 and 33/6.6 kV**
 Vector Group DY1, YY0, DY11

- Rating 3, 5, 7.5, 7.5/15, 10, 15, 12/24,15/30, 20/40 MVA
 - Tapping Range -5% to +15%, -10% to +10% (on load)
 - **Voltage Ratio 22/11 and 22/6.6 kV**
 - Vector Group DY1
 - Rating 5, 10, 12.5, 14 MVA
 - Tapping Range -5% to +15%, -10% to +10% (on load)
 - **Voltage Ratio 33/LV (433V)**
 - Rating 300 kVA and less
 - Tapping Range -5% to +5% (off load)
- Switchgear
 - **33kV Circuit Breakers**
 - Current Rating 400, 800, 1200, 2000, 2200 Amps
 - Fault rating 13.1, 17.5, 20, 25 kA
 - **22kV Circuit Breakers**
 - Current Rating 400, 800, 1200, 2000 Amps
 - Fault rating 13.1, 17.5, 25 kA

4.1.3 11 & 6.6 kV System

- Distribution Transformers
 - Vector Group DY11
 - Voltage Ratio 11 or 6.6 kV/LV (433 V, 500 V or 250 V)
 - Rating 1000, 500, 315, 200 kVA and less
 - Tapping Range -5% to +5% (off load)
- Switchgear (11kV and below)
 - Current Rating: 400, 630, 800, 1250 A
 - Fault rating: 250MVA or 350MVA - some pole mounted switchgear may be rated below 250MVA.

4.1.4 Telecontrol

Normally all 22kV or higher voltage switchgear is equipped with telecontrol. Use of telecontrol at 11kV is considered according to the situation and location.

4.1.5 Batteries

SEPD will normally provide its own battery systems for substation protection and control equipment where needed. However, shared use is considered if appropriate.

4.2 Power Quality

4.2.1 Harmonics

Engineering Recommendation G5/5 sets the planning levels for harmonic voltage distortion to be used for the connection of non-linear equipment. These levels should not normally be exceeded when considering the connection of non-linear loads and generating plant to the distribution networks under the Distribution Code. The table below gives a summary of Total Harmonic Distortion (THD) planning levels:

System Voltage at point of common coupling	THD Limit
LV ($\leq 400V$)	5%

HV (< 20kV)	4%
EHV (< 400KV)	3%

Table 1 – Total Harmonic Distortion Limits

The assessment procedure for non-linear equipment uses three stages:

- Stage 1 – connection of equipment of limited size to LV networks without individual assessment.
- Stage 2 – connection of larger equipment than the maximum in Stage 1 to all systems less than 33kV. Measurements may be necessary. Predicted levels need to be less than specified levels.
- Stage 3 – connection at 33kV and above or loads not acceptable under Stage 2. Measurement of existing harmonic distortion will be necessary.

The objective is to balance the degree of detail with degree of risk that the connection of the particular equipment will result on the supply system.

4.2.2 Voltage Fluctuations

Engineering Recommendation P28 sets the planning limits of voltage fluctuations caused by industrial, commercial and domestic equipment. Allowable limits vary with the interval between fluctuations and are based on the likelihood of customer complaints. Normally acceptable values are 3 % and below.

4.2.3 Unbalance

Engineering Recommendation P29 sets the limits of voltage unbalance on networks up to 132kV. Normally acceptable values are 2% and below.

4.2.4 Investigations

There are no areas in SEPD where harmonic levels, voltage fluctuations or unbalance are known to be an issue. However, we will investigate and take measurements in response to customer requests. If the harmonic level is found to be unacceptable, we will seek an appropriate solution.

4.3 Method of Earthing

4.3.1 132kV systems

These systems normally use multiple direct neutral point earthing.

4.3.2 High Voltage System

The methods currently employed to earth the neutral of High Voltage networks at EHV/EHV and EHV/HV substations are:

- Direct Earthing

The only impedance between the transformer lower voltage winding star point (neutral) and earth consists of the earthing conductor and the resistance between the earth mat and earth.

- Resistance Earthing

Use is made of an earthing resistor between the transformer lower voltage winding star point (neutral) and earth to limit the earth fault current.

- Earthing Transformers

In instances where the transformer lower voltage winding is delta connected a neutral point is derived artificially by inclusion of an earthing transformer. This neutral point is then appropriately earthed.

4.3.3 Distribution Substations

Earthing is provided for HV metal work, LV neutral and extraneous metal work not associated with the power system e.g. fences etc.

Where the overall resistance to earth does not exceed 1ohm the HV metal work, LV neutral earth and fence metal work (within 2 metres of HV metal work) are combined. Where the overall resistance to earth exceeds 1 ohm HV metal work earth, LV neutral and fence metal work earths are kept separate and resistance to earth of each separate earth electrode must not exceed 40 ohms.

4.3.4 Low Voltage System

The method applied to earth the LV system of most new networks and many existing networks is Protective Multiple Earthing (PME). This refers to the use of the supply neutral conductor of the LV network to provide earthing facilities for customers. There is also use of Continuous Earth Wire, Separate Neutral and Earth and Protective Neutral Bonding systems.

The general requirements that must be fulfilled are:

- The supply neutral conductor will be connected to an earth electrode at or near the transformer star point.
- The supply neutral conductor will not contain a fusible cutout, circuit breaker or switch.
- The value of the transformer neutral earth electrode will not exceed 40 ohms.
- The overall resistance to earth of the supply neutral conductor will not exceed 20 ohms.

In addition to the neutral earth at or near the transformer star point, the supply neutral conductor will be connected to other points either to earth electrodes or supply neutral conductor of another distributing main.

4.4 Protection Systems

4.4.1 General

Protection equipment is used to recognise, locate and initiate removal of a fault or abnormal condition from the power system, normally by operation of a switching device. Circuit breakers and relays are normally used at higher voltages, but fuses are employed where relays are not economically justified.

To avoid unnecessary damage to plant and equipment and to minimise disconnection of healthy plant, it is essential that the protection systems employed on the distribution system are reliable, selective, fast and sensitive.

4.4.2 LV Feeders

In most cases low voltage feeders are protected by fuses. These provide short circuit protection to the main feeder and connected services. The fuses are rated to provide discrimination with HV protection.

4.4.3 11kV/LV Transformers (Ground Mounted)

Ground mounted 11 kV / LV transformers are normally protected by HV fuse switches. The fuses provide protection for faults on the HV cable to the transformer, faults within the transformer and faults on the LV connections.

4.4.4 11kV/LV Transformers (Pole Mounted)

Pole mounted 11 kV / LV transformers receive protection from either feeder circuit breaker, pole mounted auto reclosers / sectionalisers or pole mounted HV fuses.

4.4.5 11kV Feeders

11 kV feeders are normally protected by circuit breakers with the following protections and typical clearance times:

- Predominantly underground circuits:
 - Inverse Definite Minimum Time (IDMT) overcurrent and earth fault protection - up to 1s, but possibly up to 3s depending on fault type and location.
- Predominantly overhead line circuits:
 - Instantaneous high set overcurrent - 150ms.
 - Time delayed overcurrent and earth fault - 400ms.
 - IDMT overcurrent and earth fault - 50ms – 3s
 - Time delayed sensitive earth fault - 7s.
 - Auto-reclosing as para. 4.6

Additional pole mounted auto reclosers are strategically located on the overhead network to limit the number of supply interruptions to customers for transient and permanent faults.

4.4.6 33/11 kV Transformers

33/11 kV transformers typically have the following protection and clearance times:

- High set overcurrent, instantaneous earth fault and restricted earth fault – 150ms.
- 3 stage standby earth fault - 1.4s, 2.1s and 2.9s.
- IDMT overcurrent and earth fault - up to 3s.
- Neutral voltage displacement protection - 3 – 10s.
- Buchholz and winding / oil temperature relays.
- Intertripping or fault throwing switch if needed to trip remote circuit breaker – 300ms or operating time of remote protection.

4.4.7 33 kV Feeders and Transformer Feeders

33kV feeders are normally protected by circuit breakers fitted with protection dependent upon feeder type (overhead or underground cable). Typical protection provided (and clearance time) is a selection from:

- Unit protection - 150ms.
- Distance protection - 150ms zone 1, 500ms zone 2, 1.3s zone 3.
- IDMT overcurrent and earth fault - up to 3s.
- Auto-reclosing as para. 4.6 for predominately overhead circuits.

Additional protection is needed if remote transformers are connected, typically:

- High set overcurrent - 150ms.
- Instantaneous earth fault - 150ms.
- Intertripping over pilot cable or fault throwing switch.

4.4.8 132/33 kV Transformers

132/33 kV transformers typically have the following protection and clearance times:

- Overall biased differential, high set overcurrent, instantaneous earth fault and restricted earth fault protections - 150ms.

- 3 stage standby earth fault protection - up to several seconds.
- Buchholz and winding / oil temperature relays.
- Intertripping or fault throwing switch if needed to trip remote circuit breaker - 300ms.

4.4.9 132 and 66 kV Busbars

132 and 66 kV busbars are normally protected by busbar protection to provide discrimination and to isolate the faulted section of busbar. Typical clearance time is 150ms.

4.4.10 132 and 66 kV Feeders and Transformer Feeders

132 and 66 kV feeders are normally protected by circuit breakers fitted with protection dependent upon feeder type (overhead or underground cable). Typical protection provided and clearance times are:

- A single main protection, either unit protection - 150ms, or distance protection - 150ms zone 1 or 500ms zone 2. Additionally, if a transformer is remotely connected:
 - High set overcurrent - 150ms.
 - High set earth fault - 150ms.
 - Intertripping may be installed.
- Back up protection to cater for failure of the main protection, normally IDMT overcurrent and earth fault - 1.1s and 1.2s, or distance protection zone 3 - 0.9s.
- Auto-reclosing as para. 4.6 for predominately overhead circuits.

4.5 Network Automation

To minimise customer minutes lost and customer interruptions due to outages, where economically viable, opportunity is taken to automate the HV distribution system by installing in-line circuit breakers or actuators.

4.6 Auto Reclosers

Most faults on overhead lines are of transient nature (e.g. insulator flash over) generally caused by wind borne materials. These faults are normally cleared by opening of the source circuit breaker or pole mounted recloser and do not recur when reclosed. Auto-reclosing is therefore applied to most predominantly overhead circuits.

Typical or preferred settings, where relays permit, are:

- 11kV source circuit breaker:
 - Trip 1 - Instantaneous high set overcurrent or time delayed overcurrent or earth fault or sensitive earth fault.
 - 10 s dead time.
 - Trip 2 - IDMT overcurrent or earth fault or time delayed sensitive earth fault.
 - 90s - 120s dead time (or lock-out if sensitive earth fault).
 - Trip 3 - IDMT overcurrent or earth fault to lock-out.
 - Reclaim time 5s.
- 11kV pole-mounted circuit breakers:
 - Settings to co-ordinate with the above.
 - Final dead time 90s or 120s.

- 33kV circuit:
 - Single shot.
 - 90s dead time.
 - 5 s reclaim time.
- 132kV circuit
 - Single shot.
 - 15s dead time.
 - 5s reclaim time.

4.7 Operating Voltages

The company's distribution system operates at nominal voltages such as 132, 66, 33, 22, 11, 6.6 kV and 230/400V.

4.7.1 General

Voltage control is applied at various voltage levels to ensure that statutory levels are maintained at customers' supply terminals as below.

4.7.2 Voltage Control of HV (11 and 6.6 kV) and LV system

Automatic control of the 11kV source voltage is obtained by the on-load tapchanger on the 132/11, 66/11 and 33/11 kV transformers. The interval between taps is typically 1.25% or 1.43%.

Line drop compensation is normally applied to rural 33/11 kV transformer tapchanger control schemes to arrange an automatic increase in the 11kV source voltage with increase in demand. Typical settings are 1.05p.u. at full load and 0.985p.u. at no load. The 11kV system is typically designed to accommodate 6% volt drop.

The low voltage system is typically designed so that the aggregate volt drop in the low voltage distributor and service does not exceed 7% with normally less than 2% in the service.

4.7.3 Voltage Control of EHV (33 and 22 kV) System


The voltage at the 33kV source is set to the highest permissible value, typically 1.03p.u., in order to permit maximum design volt drop in the 33kV system. It is also chosen to ensure that the required 11kV and LV busbar voltages at both nearby and remote substations can be achieved.

4.7.4 Voltage Control of 132kV System

The 132kV voltage at a 400/132 kV Grid Supply Point is maintained by the National Energy System Operator (NESO) at a mutually agreed level and is usually between 1.00 and 1.05 p.u. Each part of the system is studied in detail taking in to account normal and abnormal conditions, circuit configuration, tap ranges, impedances, demand and voltage required at the 33kV busbars.

4.8 Generation Connection Policy

The principal duty placed on the Authority is to protect the interest of consumers having regard to the need to secure that all reasonable demands for electricity are met. This duty is devolved to the licensee to develop the distribution systems in an economical manner whilst maintaining defined planning standards. The implications are that whereas demand for electricity must be met year-round, generators will not always be able to simultaneously generate at their authorised capacity since the supply and demand for electricity must be balanced



at all times. Therefore, it is necessary that, before any offer for connection is made, detailed network analysis is carried out to ascertain the impact of generation so that the quality of supply to connected consumers is not compromised.

Generators connected to the LV, HV or EHV distribution system must comply with the general principles specified in Engineering Recommendation G99 and associated Engineering Technical Report no.113 or G98 as applicable. Where appropriate, the requirements of the Distribution Code and Grid Code must be met.

It is a requirement that Neutral Voltage Displacement will be fitted to all generators where the size of the generator or group of generators on the same connection point exceeds 200kVA. This is to ensure that the risks of back-energising the 11kV network from an LV generator is small.

4.9 Load Management Areas

In compliance with the Grid Code and on receipt of instructions from NGC, voltage reduction may be applied to reduce demand and maintain system frequency. There are no load management areas in SEPD.

4.10 Network Constraints and Opportunities

There are constraint areas for accepting new generation or load. The background fault levels at most voltages are generally high. This is due to a higher fault infeed from the 400kV transmission system and the lower impedance of the distribution system.

There is currently about 2764MW of embedded generation connected to the distribution system at various voltages across the whole area served by SEPD.

The continued growth in generation connecting at distribution voltages is driving ongoing improvements in how SEPD seeks to provide information and assistance to customers wishing to connect to its network.

The current trend of growth in generation connections has reinforced the importance of SEPD continuing to develop and recognise its responsibility to provide information and assistance. This is coupled with the ongoing need for strong customer interaction and support to potential distributed generation customers.

It is essential that prospective generation developers work with SEPD to ensure correctly located and well-matched generation is incorporated into its network to the mutual benefit of both customers and SEPD.

Key areas that need to be discussed and monitored are the impacts of the generation on the network and the impacts of the network on the generation.

The addition of generation to the network impacts the system fault levels, which in turn can lead to network reinforcement works being necessary to support the connection. The power flows experienced by the modified network, if not accurately analysed, monitored and controlled, could cause system overload, over and under voltage, system frequency variations and reduce system power factors. All of these are undesirable on the distribution network. All are points that must be considered when designing and developing a generation connection.

Networks may well have to be redesigned to best adapt to the generation connection requirement. This will add both cost and time to the connection project and should be considered and remembered when submitting any such connection enquiry or request.

Connection of well sited and adaptable generation could provide network support and reduce network losses. The development must supplement SEPD's responsibility to deliver a safe, secure and reliable network and be in keeping with our ethos to "deliver energy in a safe and sustainable way".

When considering connecting new load or generation to the network, it must be thoroughly planned and designed to meet the requirements set out in the Distribution Code, and in line with the information contained within this LTDS document.

Depending upon connection size and type, an application may need to be made to National Energy System Operator for a "Statement of Works" OR "Modification Application". This can be discussed at the point of request

for information or during the initial scoping of any connection enquiry. There may be charges associated with these applications.

The following short guide may assist users who wish to complete initial investigations and assessments of proposed connections to SEPD's network.

Key Milestones in the investigation process.

Fill out a generation connection form, available from the ENA Resource Library website and submit this to SSEN: <https://www.energynetworks.org/industry/connecting-to-the-networks/>

This will commence dialog with the company in relation to the connection request.

- Identify your new Connection, Generation or Load.
- State the capacity and type of generation to connect; Wind, Solar, Hydro, combined Heat and Power systems, Bio-mass or other.
- Unless a specific location is required, select an area on the LTDS geographic map or select a substation local to the desired connection area.
- Using the information available in the LTDS investigate that the selected substation's capacity, demand, forecast demand and fault level could support the new connection.
- Collect technical data from LTDS and perform self study
 - Carry out study of the impact of new generation on the existing network parameters including;
 - Fault level contribution of connecting new generator
 - Clean or dirty load giving rise to System harmonics
 - Impedance of the unit, how will this alter fault level?
 - What is the effect under 1st circuit outage conditions?

Connection charges will vary with the location and size of the proposed connection. At the point of connection request or enquiry, costings will be advised in line with the Southern Electric Power Distribution Statement of Methodology and Charges for Connection to Southern Electric Power Distribution' Electricity Distribution System.

<http://www.ssen.co.uk/Library/ChargingStatements/SEPD/>

Applications for connection of generation are evaluated on an individual basis.

Information on generation connections and applications can be found in Table 5 and Table 6 of this statement's data section which summarises larger embedded generation installations in SEPD's area.

4 GEOGRAPHIC AND SCHEMATIC PLANS

The following are shown separately on maps provided with the main LTDS document:

- Schematic plans for the EHV system showing the electrical connectivity of the system.
- Geographic maps showing routes of EHV circuits and the location of EHV/EHV and EHV/HV substations.

Maps of larger scale for EHV, HV and LV systems for a particular area are available on request. A price list for these is included in Appendix 1.

5 SOURCES OF NETWORK AND CHARGING INFORMATION

As described in Summary Information Section 2.1.3, the statements which set out the basis of the "Use of System" and "Connection to the Distribution System" charges are as follows:

- Statement of charges for use of Southern Electric Power Distribution plc's distribution system;
- Statement of charging methodology for use of Southern Electric Power Distribution plc's distribution system.
- Statement of charging methodology for connection to Southern Electric Power Distribution plc's distribution system.

All the above statements are available on the SSEN website at www.ssen.co.uk or by sending an email to connections@sse.com

6 NETWORK INTERFACES

The Distribution Code (<http://www.dcode.org.uk/>) specifies the process for managing network development at interface point with users, which includes other Network Operators. It also describes the interface with the National Electricity Transmission System.

SEPD's distribution system above 11kV interconnects with:

- The transmission system of National Energy System Operator at the following locations:
 - Acton Lane 66/22 kV substation (this also supplies UK Power Networks plc (UKPN) distribution system),
 - Amersham 400/132 kV substation (this also supplies UKPN's system),
 - Axminster 400/132 kV substation (this also supplies WPD's system),
 - Botley Wood 400/132 kV substation,
 - Bramley 400/132 kV substation,
 - Chickerell 400/132 kV substation,
 - Cowley 400/132 kV substation,
 - Ealing 275/66 kV substation,
 - East Claydon 400/132 kV substation,
 - Fawley 400/132 kV substation,
 - Fleet 400/132 kV substation,
 - Iver 275/132/66 kV substation,
 - Laleham 275/132 kV substation (this also supplies UKPN's distribution system),
 - Lovedean 400/132 kV substation,
 - Mannington 400/132 kV substation,
 - Melksham 400/132 kV substation,
 - Minety 400/132 kV substation,
 - North Hyde 275/66 kV substation,
 - Nursling 400/132 kV substation,
 - Willesden 275/66 kV substation (this also supplies UKPN's distribution system),

- Tynemouth 275/11 kV substation.
- National Grid Electricity Distribution (South West)'s distribution system at:
 - Yeovil 132/33 kV substation,
 - Winterborne Abbas 33kV substation,
 - Melksham 132kV substation.

Contact details for these companies are:

UK Power Networks
Fore Hamlet
Ipswich
IP3 8AA

National Energy System Operator
NGT House
Warwick Technology Park
Gallows Hill
Warwick
CV34 6DA

National Grid Electricity Distribution (South West) plc
Avonbank
Feeder Road
Bristol
BS2 0TB

DETAILED INFORMATION

8 OVERVIEW OF THE SYSTEM

The following table shows the volume of Southern Electric Power Distribution's distribution network.

Overview of the System			
Voltage		23/24 Volume	
132kV	Overhead Line	km	1,887.11
	Cable (not inc. subsea)	km	528.84
	Subsea Cable	km	14.54
	Transformers	132/33 & 132/11kV	209.0
66kV	Overhead Line	km	5.95
	Cable	km	170.11
	Transformers	66/22 & 66/11 kV	55.0
EHV	Subsea Cable	km	4.93
HV	Subsea Cable	km	3.59
33 and 22 kV	Overhead Line	km	3,296.53
	Cable	km	2,522.58
	Transformers	33kV Ground Mounted	903.0
	Transformers	33 kV Pole Mounted	54.0
11 and 6.6 kV	Overhead Line	km	12,428.26
	Cable	km	18,439.84
	Transformers	11 or 6.6kV/LV ground and pole mounted	59,147.0
Low Voltage	Overhead Line	km	90,98.06
	Cable	km	30,730.94

Table 2 – SEPD Network Volumes

8.2 Network Data

The following data are included in this LTDS.

8.2.1 Circuit Data

The electrical parameters for EHV circuits are shown in Table 1 of this statement's data section. Circuit rating information relates to the main item i.e. cable or overhead line and is based on the smallest cross section. Cyclic ratings are given where appropriate. In practice other items such as current transformers, protection equipment and isolators may restrict the circuit rating. The information is intended to illustrate the basic circuit capability. The majority of circuits operate at their construction voltage.

8.2.2 Transformer Data

EHV/EHV and EHV/HV transformer data is shown in Table 2. A site-specific analysis can be carried out to ascertain the reverse power capability of each transformer.

8.2.3 Demand Data

The maximum demand recorded at the substation is shown in MW and power factor in Table 3. The forecast demand is based on our Distribution Future Energy Scenarios (DFES) projections, specifically the Consumer Transformation (CT) scenario and the contracted jobs. The DFES projections and contracted jobs for 2023/24 are shown alongside the actual recorded values for a direct comparison. DFES projections for the next 5 years are shown where available, otherwise the forecast is based on the historical growth trend plus any large known developments. Diversity factors are applied to the contracted jobs depending on the voltage level and the requested. Firm capacity for multiple transformer sites relates to the remaining capacity under n-1 (largest unit loss), although higher loads can often be supplied by using load transfers or mobile or local generation. Note that limitations in the higher voltage network may restrict spare capacity. For single transformer sites the demand will normally be secured by use of interconnection, mobile generation or combination of both.

The minimum load scaling factor is the ratio of minimum to maximum demand.

Appendix 2 shows typical substation load profiles.

8.2.4 Fault Level Data

Calculated three phase fault level (plus single phase fault levels for 132kV) data under normal running arrangements is shown in Table 4A (132kV) and Table 4B (6.6, 11, 22, 33 and 66 kV). Normally there will be more than one circuit breaker at a substation site; the make and break ratings shown relate to the existing circuit breakers. At most sites, not all circuit breakers would be subject to the fault currents given.

Fault currents given include contributions from all transmission and distribution networks and generation included in our study model. The break current will be dependent on the break time. Break current values given in this statement are decremented RMS values at 50ms. This decay time is a conservative assumption and may vary for some sites. Make values include contributions from induction motors as per Engineering Recommendation G74. Normally break and make fault currents will not be allowed to exceed switchgear ratings.

8.2.5 Connected Generation

Table 5 details the substation and connection voltage of various types of generation connected to the network. All listed units are greater than 1MW generation capacity.

8.2.6 Interest in a connection

Table 6 details the recent interest in connection of various load and generation connections by substation. The table presents the number of formal and budget enquiries, the number of accepted applications and the total cumulative capacity of all applications.

8.2.7 Busbar and node codes

Table 7 details the busbar and node codes used in the Tables. There are also diagrams that show how the various busbars interconnect. These can be found separately on the Long Term Development Statement webpage.

8.3 Other Information

Additional information is available on request:

- Circuits e.g. zero sequence impedance.
- Transformers e.g. earthing details, hot sites.
- Demand e.g. limitation on firm capacity, demand duration profiles.
- Fault Level e.g. contributions to fault current at each node, decremented break fault currents, details of limitations and indicative cost to relieve.

A price list for provision of such additional information is included in Appendix 1; contact details are in Part 1 Section 3.

9 NETWORK DEVELOPMENT PROPOSALS

Appendix 3 lists financially approved distribution system reinforcement proposals. These schemes are either under construction or are in the design stage.

10 UPCOMING CHANGES TO THE FORM OF THE LTDS

On the 10th of January 2024, Ofgem opened the Formal Consultation for the LTDS reform, outlining proposed changes for how DNOs will produce and publish LTDS data moving forward. This reform intends to improve the usability of LTDS as DNOs are required to publish network models in Common Information Model (CIM) format, removing the need for customers to build models themselves. This consultation was followed up by a Formal Direction Letter published 30th of April 2024, which includes a suite of supporting documents including the new LTDS Form of Statement (FoS). On the 25th of November 2024, Ofgem published the Formal Approval of Extension (Derogation) for CIM Implementation into the Long Term Development Statement that was requested by DNOs. SSEN are currently working on the staged implementation of the LTDS reform outlined by Ofgem. Below provides a summary of each stage of the LTDS reform and the associated timescales.

Stage 1: Existing Equipment (EQ) Model

This stage requires DNOs to produce and publish a CIM Physical grid Model (EQ profile only) representing the existing grid of the entire licence area. While this stage will provide the EQ data within the model, users will still require the data from existing LTDS tables to run power flow studies. EQ profiles had to be completed by 15 October 2025 and published in the November 2025 LTDS submission as an extension to the previous deadline is agreed upon with Ofgem..

Stage 2: Existing & Future Equipment (EQ), Short Circuit (SC) and System Capacity (SYSCAP) Models

This stage requires DNOs to produce and publish CIM Physical grid Models (EQ and SC profiles) representing the existing grid of their licence area accompanied by a SYSCAP profile Model. Data included at this stage includes historic peak load, system capacity, and fault level information. Models of the network representing each of five future years are also required at this stage. Models at this stage could provide sufficient data for a power flow

study. Users could use this approach for both the existing network and for planned future changes reflected in future year models. This stage is planned to be completed by 15 April 2026 with models being published in the May 2026 LTDS submission as an extension to the previous deadline is agreed upon with Ofgem.

Stage 3: Complete LTDS in CIM Grid Model Data with Solved Cases and Geospatial Location (GL) Model

This stage is intended to provide geo-location of substations and circuits enabling understanding of the physical distance between a proposed development and the surrounding network. Schematic diagrams generated from, and related to, the underlying network model provide users with reliable visualisation of network data. Solved cases will allow users to validate their power flow calculations against our solutions, including information about future development projects or accepted-to-connect projects. This stage is planned to be completed by 15 August 2026 with models being published in the November 2026 submission as an extension to the previous deadline is agreed upon with Ofgem.

The current format of the LTDS is proposed to be retired over the staged implementation of the reform. We are expecting that Ofgem will announce the new retirement dates for the current format of the LTDS in due course as the extension for delivering Stages 1.3, 2 and 3 was agreed by Ofgem recently.

[Long Term Development Statement direction | Ofgem](#)

The Ofgem Formal Approval of Extension (Derogation) for CIM Implementation into the Long Term Development Statement can be found on Ofgem's website.

[LTDS CIM Derogation Letter | Ofgem](#)

10 FURTHER INFORMATION

10.1 Distribution Code

See: www.dcode.org.uk

10.2 Electricity Ten Year Statement

See: <https://www.neso.energy/>

10.3 Engineering Recommendations

Copies of National Engineering Recommendations and Technical Specifications are available from:

Energy Networks Association
6th Floor
Dean Bradley House
52 Horseferry Road
London
SW1P 2AF
Tel: 020 7706 5100
Email: info@energynetworks.org
or
www.energynetworks.org

APPENDIX 1

NETWORK INFORMATION PRICE LIST

SEPD will be able to provide additional and/or site-specific network information on request. The price list given below is for general data which is normally available but will require time and effort to collect. The person making the request should define the specific areas of interest including details of the substation group and the substation or busbar node names.

For some site-specific enquiries and for those items which are not included in the list below, it may be necessary to carry out network analysis, site checks and in some cases shut down of the network to obtain information. A quotation will be provided to the customer before work is undertaken.

Network Data

a) Reliability Data

Typical reliability data for EHV, HV and LV system	£25 per voltage
Specific circuit reliability data	£100 per circuit

b) Demand Data

Specific demand (maximum and minimum) data - normal £100 per circuit running for EHV and HV circuits

c) Impedance Data

Specific 11 kV circuit impedance data	£50 per circuit
Specific EHV circuit data additional to LTDS standard data	£50 per circuit

d) Plant Data

Rating, fault levels rating and protection details without site £100 per site visit. (Where site visit is required, price will be provided on request)

Any request for the above information should be sent in writing (see Part 1 Section 3 for contact details) accompanied with a cheque payable to Southern Electric Power Distribution plc. Under normal situations return of information will be within 15 working days.

Geographic Mapping Information


Maps and network plans are available on request from our Mapping Services department.

One set of specific EHV system map with OS background	£50 per set
One set of specific EHV schematic diagrams	£50 per set
One set of specific HV system map with OS background	£50 per set
One set of specific HV schematic diagrams	Price on request
One set of specific LV schematic diagrams	Price on request

“One set of specific system mapping” Is defined as a 2km area centred as requested by the customer. This can be produced in either paper format or as a digital shape file or PDF.

Mapping Services can offer access to our GIS mapping system information via the internet. This would allow repeated access at user’s convenience. Requests for this service should be made directly to Mapping Services via email: asset.data@sse.com

This service may be subject to access and set up fees.



Any request for the above information should be sent in writing accompanied with a cheque payable to Southern Electric Power Distribution plc to;

Mapping Services
Daneshill Depot
Faraday Road
Basingstoke
Hampshire
RG27 8QQ

Email: asset.data@sse.com

OR

Connections and Engineering
Customer Service Centre
Southern Electric Power Distribution
Walton Park
Walton Road
Cosham
Portsmouth
PO6 1UJ

Email: connections@sse.com

All prices are subject to VAT at current rates

In some cases, it will be necessary to obtain information from manufacturers or suppliers. Southern Electric Power Distribution will use its best endeavours to obtain this but cannot be held responsible for non-provision or delayed provision of such information. Any additional cost to provide such information will be advised.

APPENDIX 2

TYPICAL 132/33 kV SUBSTATION LOAD PROFILES



The following box plots illustrate typical load profiles for 132/33 kV Substations in Urban, Rural or Mixed environments.

Two sets of graphics for each environment are shown, a yearly profile and a daily profile.



Yearly (1 January – 31 December)

Daily (midnight – midnight)



Urban

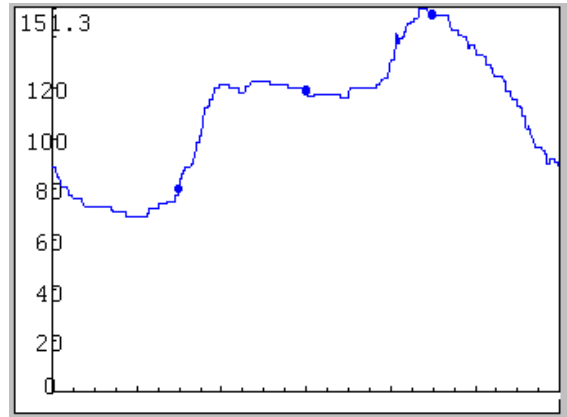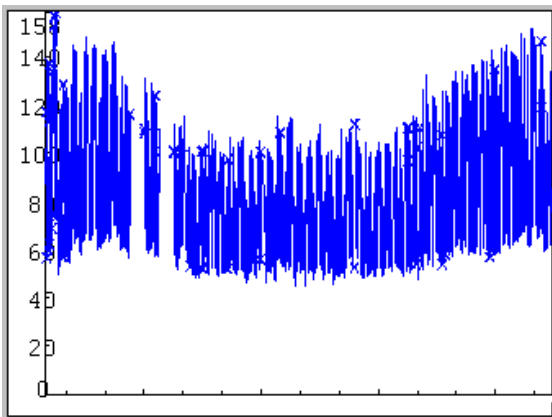

Rural

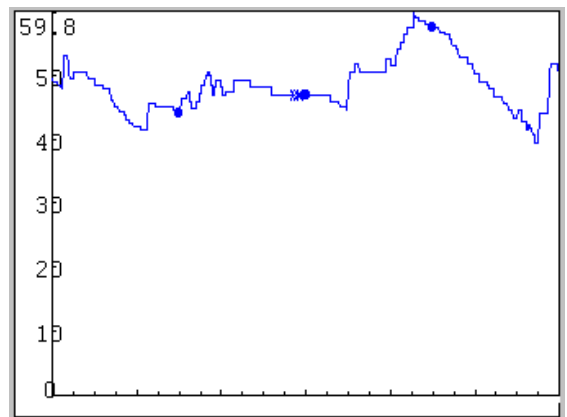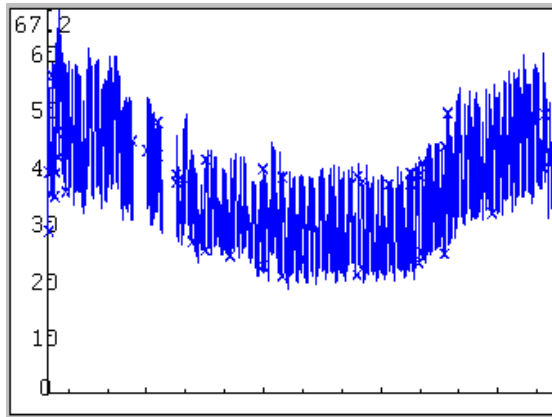

Mixed area

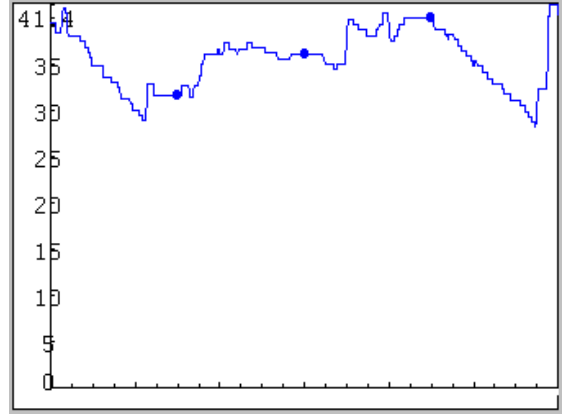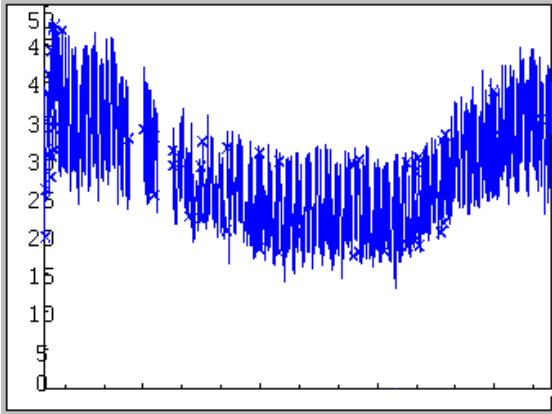

TYPICAL 33/11 kV SUBSTATION LOAD PROFILES



The following box plots illustrate typical load profiles for 33/11 kV Substations in Urban, Rural or Mixed environments.

Two sets of graphics for each environment are shown, a yearly profile and a daily profile.

Yearly (1 January – 31 December)



Daily (midnight – midnight)

Urban

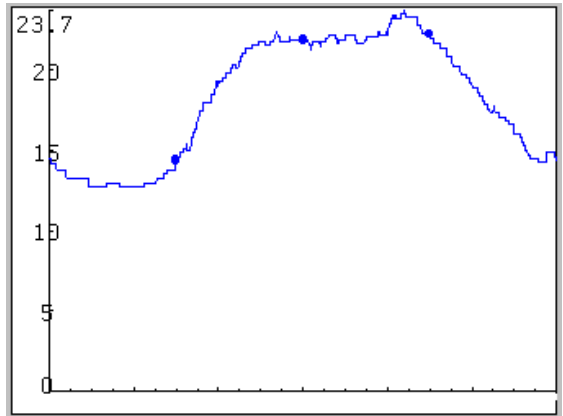
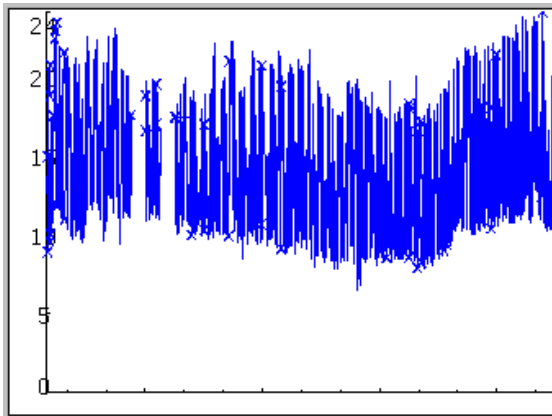




Rural

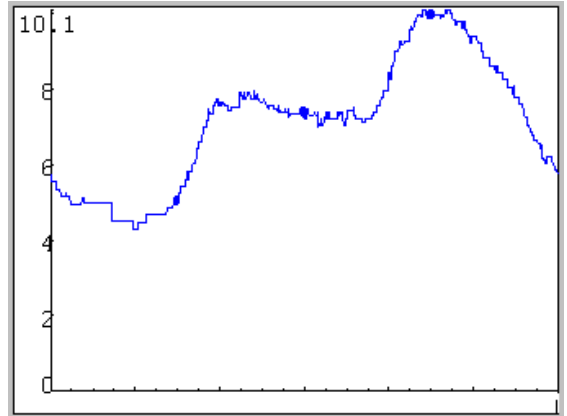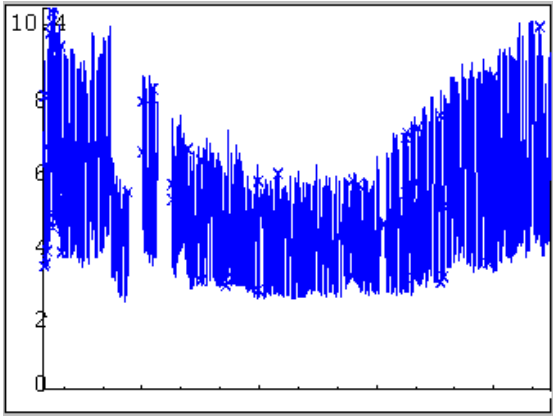

Mixed area

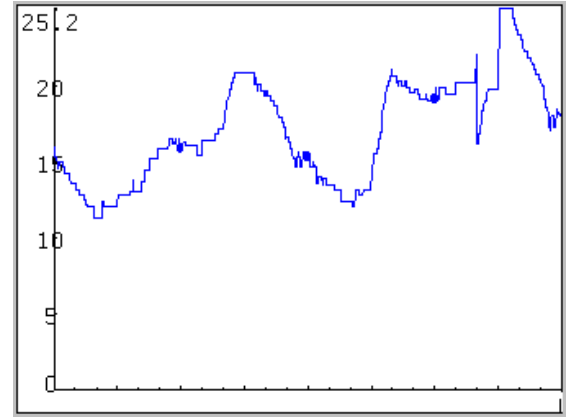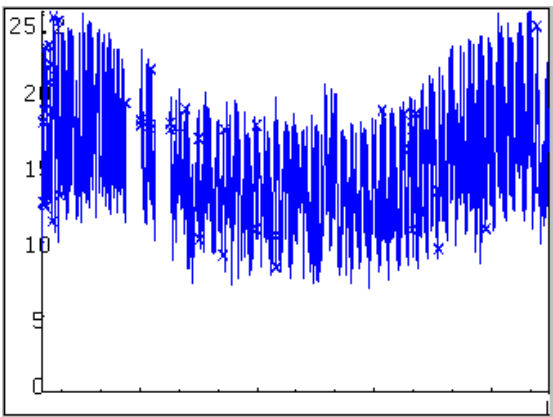

APPENDIX 3

NETWORK DEVELOPMENT PROPOSALS

Network Reinforcement Projects

GSP	Name	Estimated Completion	Impact on Distribution Network Capability	Changes from previous LTDS
Bramley	Andover/ Amesbury 132kV reinforcement	Complete	Carry out 132kV bus work at Andover (10710) substation to effectively swap Amesbury and Andover BSP's so that Andover is now supplied from Melksham and Amesbury is supplied from Bramley	Aug-24
Bramley	Reading to Little Hungerford to Arborfield - 33kV circuit reinforcement	Dec-24	Upgrade the circuits between Reading (21930), Little Hungerford (86804) and Arborfield (87101) to increase capacity and reconfigure the auto-changeover arrangement	Completion date changed from Aug-24
Fleet	Coxmoor Wood – Crookham rutter pole replacement	Dec-24	Install two new 33kV circuits between Coxmoor Wood (14130) and Crookham (87400) substations to mitigate an outage issue	No Change
Lovedean	Rose Green - Hunston rutter pole replacement	Feb-25	Install two new 33kV circuits between Rose Green (22330) and Hunston (17530) substations to mitigate an outage issue	Completion date changed from Oct-24
Fleet	Petersfield 33kV reinforcement. Alton - Fernhurst split	Mar-25	Reconfigure and reinforce the 33kV network between Petersfield 33kV (21030), Alton 33kV (10330) and Fernhurst 33kV (15730) substations	Completion date changed from Jun-24
Mannington	Salisbury/Amesbury 132kV Network Improvements	Mar-25	Installation of a 132kV isolator at Amesbury 132kV substation (10510-10513) and connection on to Salisbury/Amesbury tee 132kV circuit 2	Completion date changed from Jun-24
Fleet	Fernhurst - Five Oaks - Plaistow - overlay existing 33kV OHL and upgrade Plaistow Transformers	Mar-25	Install a new 33kV circuit between Fernhurst (87214) and Five Oaks (15830) substations to mitigate an outage issue as well as installing a new 33/11 kV transformer at Plaistow (87215)	Completion date changed from Oct-24

Lovedean	Havant - Horndean / Waterlooville - Horndean Rutter pole replacement	Mar-25	Install a new 33kV circuit between Havant (16930) and Waterlooville (87803) and Horndean (88002) substations to mitigate an outage issue	No Change
Mannington	Shaftesbury-Bourton 33kV Circuit Reinforcement	Mar-25	Reinforce the 33kV network between Shaftesbury 33kV (23130) and Bourton 33kV (89504) substations	No Change
Lovedean	Shripney - Argyle Road - South Bersted - Under Grounding 33kV Circuits	May-25	Install four new 33kV circuits between Shripney (25430) and Argyle Road (10830) and between Shripney and South Bersted (22730) substations to mitigate an outage issue	No Change
Cowley	Bicester to Upper Heyford 33kV rutter pole replacement	Jun-25	Install new 33kV cable sections between Bicester (86002,86005) and Upper Heyford (86010,86011) to replace the existing dual rutter pole overhead line circuits.	No Change
Chickerell	Dorchester Town 11kV Substation Connection Upgrade	Jul-25	Upgrade transformer feeders to match with the Tx rating	New
Fleet	Bordon and Alton/Fernhurst 33 kV reinforcement	Sep-25	Install a new 33kV circuit between Bordon and Budds Lane, new switchgear at Bordon 33kV (12130-12132) and split the Alton/Fernhurst BSPs	No Change
Nursling	North Baddesley 33/11 kV Transformers replacement	Sep-25	Reinforcement of the existing transformers with higher rated assets to increase the substation firm capacity at North Baddesley primary (88612)	No Change
Fleet	Aldershot - Farnham 33kV rutter pole replacement	Nov-25	Install two new 33kV circuits between Aldershot (10130) and Farnham (87005, 87006) substations.	No Change
Nursling	Rownhams - North Baddesley 33kV	Mar-26	Replacement of 1.5 km of dual circuit overhead line and 0.1km of 33kV cable between Rownhams (22430) and North Baddesley to increase firm capacity	Completion date changed from Jun-25

Willesden	Canal Bank 22/6.6 kV System Reinforcement	Mar-26	Install two new 66kV cables from Willesden to Canal Bank (92011) substation, two 66/11 kV 40MVA transformers and a new 11kV switchboard. It will also include a load transfer from Park Royal. This will create sufficient capacity for local development and improve security of supply in the area.	Completion date changed from Jul-25
Ealing	Southfield Road 66/11 kV Transformer Replacement	Mar-26	Reinforcement of the existing transformers with higher rated assets to increase the substation firm capacity at Southfield Road primary (93003 and 93004)	No Change
Fleet	Coxmoor Wood / Wrecclesham Rutter pole replacement	Mar-26	Install a new 33kV circuit between Coxmoor Wood (14130) and Wrecclesham (87406) substations to mitigate an outage issue	No Change
Botley Wood	Netley Common 132/33 kV Transformer	May-26	Add an additional 132/33 kV transformer and 33kV circuit breaker at Netley Common BSP (20230)	No Change
Lovedean	Shripney - Bilsham OHL rutter pole overlay	Jun-26	Install a new 33kV circuit between Shripney (23430) and Bilsham (11530) substations to mitigate an outage issue	No Change
Nursling	Rownhams 33kV network - GR Rownhams motorway service area	Jun-26	Reinforce transformers at Wheatley primary and sections of the network	New
Botley Wood	Netley Common 33kV circuit breakers reinforcement	Jun-26	Bitterne Primary/ 7x 33kV indoor circuit breaker in Netley Common 33kV.	New
Lovedean	Birdham Network Reinforcement	Jun-26	33kV OHL reinforcement Hunston 33kV to Birdham primary / rutter pole replacement.	New
North Hyde	Hayes 11kV reinforcement	Oct-26	Install another circuit breaker at the new GIS double busbar and adding a third transformer, circuit and replacing the 11kV switchboard.	New
Cowley	Wheatley 33kV Circuit and Transformer reinforcement	Dec-26	Reinforcement of the existing feeder circuits and transformers with higher rated assets to increase the substation firm capacity at Wheatley primary (86109)	Completion date changed from Mar-26

Lovedean	Hunston / Birdham / Selsey Rutter pole replacement	Dec-26	Install a new 33kV circuit between Hunston (17530), Birdham (11630) and Selsey (22930) substations to mitigate an outage issue	Completion date changed from Jun-26
Cowley	Rose Hill 33kV network reinforcement	Dec-26	Network reinforcement in Rosehill 33kV	New
Mannington	Reinforcement of Winton 33/11 kV transformers	Dec-26	Install 33kV switch board at Winton primary and transformer reinforcement.	New
Botley Wood	Bishops Waltham 33kV Circuit and Transformer reinforcement	Mar-27	Reinforcement of the existing feeder circuits and transformers with higher rated assets to increase the substation firm capacity at Bishops Waltham primary (88217)	No Change
Cowley	Witney Town 33/11 kV Transformers replacement	Mar-27	Reinforcement of the existing transformers with higher rated assets to increase the substation firm capacity at Witney Town primary (25550)	No Change
Mannington	Swanage 33/11 kV Transformers replacement	Mar-27	Reinforcement of the existing transformers with higher rated assets to increase the substation firm capacity at Swanage primary (89614)	No Change
Melksham	Bruton 33kV Circuit reinforcement	Mar-27	Reinforce the 33kV circuit between Frome (16130) and Bruton (85215) to increase network capacity	No Change
Cowley/Bramley (Fleet)	Cholsley - Goring 33kV Circuit reinforcement	Mar-27	Reinforce the 33kV circuit between Cholsley (85901) and Goring (86675) to increase network capacity	No Change
North Hyde	North Hyde 22kV reinforcement	Mar-27	North Hyde 22kV bsp Strategic investment	New
North Hyde	Bath Road East 66/11 kV reinforcement	Mar-27	Replacing existing transformers, the 11kV switchboard and the circuits upstream to North Hyde 66/11 kV substation.	New
Minety	Faringdon 33kV network reinforcement	May-27	Install two new circuits between Stratton Reserve and Faringdon and two new transformers at Faringdon.	New

Lovedean	Fort Widley - 132kV transformer reinforcement	Jun-27	132/33 kV transformer replacement in Fort Widley	New
Lovedean	Horndean primary reinforcement	Jun-27	Install new transformer in Horndean primary	New
Iver 132kV	Denham 132kV Circuit reinforcement	Jun-27	Reinforce the 132kV circuit between Iver 132 (17610) and Denham (14611) to increase network capacity	Completion date changed from Mar-26
Lovedean	Horndean dual circuits, Waterlooville 33kV and Fort Widley 33kV reinforcements	Jun-27	Install dual circuits in Horndean, Waterlooville 33kV switchgear, Fort Widley 33kV switchgear	New
Lovedean	Selsey Network and 33kV Reinforcement	Jun-27	33kV OHL reinforcement Hunston 33kV to Selsey primary/ rutter pole replacement.	New
Nursling	Romsey 33/11 kV Tx upgrade	Jun-27	Install new transformers and circuit breakers at Romsey primary.	New
North Hyde	North Hyde primary reinforcement	Jun-27	Upgrade transformers at North Hyde primary.	New
Willesden	Leamington Park Substation - Uprate 6.6kV Network to 11kV	Aug-27	Install two 22/11 kV, 24MVA transformers and new 11kV switchgear (92128)	Completion date changed from Aug-26
North Hyde	Springfield Road 22/6.6 kV reinforcement	Nov-27	Establish the new 132kV (operated at 66kV) extension busbar at North Hyde compound.	New
Cowley	Fulscot 33kV Circuit Reinforcement	Mar-28	Reinforce the 33kV network between Drayton (14830) and Fulscot (85902) to increase network capacity	No Change
Lovedean	Ashling Road 33/11 kV Transformers replacement	Mar-28	Reinforcement of the existing transformers with higher rated assets to increase the substation firm capacity at Ashling Road primary (11050)	No Change
Bramley (Basingstoke)	Basingstoke - Overton - Bramley Green 33kV Circuit reinforcement	Mar-28	Reinforce the 33kV circuit between Basingstoke (11231), Overton (87116) and Bramley Green (87103) to increase network capacity	No Change

Cowley	Berinsfield 33kV Circuit reinforcement	Mar-28	Reinforce the 33kV circuit between Osney (13831) and Berinsfield (85801) to increase network capacity	No Change
Lovedean	Chichester - Shripney 33kV Circuit reinforcement	Mar-28	Reinforce the 33kV circuit between Chichester (13231) and Shripney (23430) to increase network capacity	No Change
Melksham	Malmesbury - Tetbury 33kV Circuit reinforcement	Mar-28	Reinforce the 33kV circuit between Malmesbury (85109) and Tetbury (85126) to increase network capacity	No Change
Bramley (Fleet)	Aldershot - Tongham 33kV Circuit reinforcement	Mar-28	Reinforce the 33kV circuit between Aldershot (10130) and Tongham (87016) to increase network capacity	No Change
Fawley	132kV Reinforcements at Fawley North 33/11 kV	Mar-28	132kV reinforcements at Fawley North primary	New
Willesden	Park Royal PSS Strategic Investment (P)	Mar-28	Install new 132kV double busbar at Perivale PSS. Park Royal would be updated to 11-6.6 kV and connected to this newly established 132kV (66kV operated) double busbar via 66kV dual circuit, 4km long. Addition of two transformers at Park Royal PSS, an HV busbar.	New
Lovedean	Chichester primary transformer reinforcement	Apr-28	Install a new transformer at Chichester primary.	New
Lovedean	South Bersted 11kV transformer reinforcement	Apr-28	Replace two existing transformers with 2x15/30 MVA.	New
Bramley (Fleet)	Alresford 33/11 kV Transformers replacement	Jun-28	Reinforcement of the existing transformers with higher rated assets to increase the substation firm capacity at Alresford primary (10050)	Completion date changed from Mar-27
Lovedean	Fareham - Hoeford 33kV Circuit reinforcement	Jun-28	Reinforce the 33kV circuit between Fareham (15330) and Hoeford (87704) to increase network capacity and alleviate an outage issue	Completion date changed from Mar-28
Fleet	33kV AIS - GIS Alton 33kV	Jun-28	Install 33kV GIS at Alton, comprising 16 circuit breakers and spares. Install new cable from A2MT to transformer breaker.	New

Botley Wood	Circuit overlay Netley Common - Woolston Primary	Jun-28	Overlay two circuit, two outdoor circuit breakers Netley Common Weston primary.	New
Melksham	33kV cable reinforcement in Whitchurch and Barton Stacey primary substations	Jun-28	New 33kV cable circuit between Whitchurch and Barton Stacey	New
Cowley	Witney 132kV network reinforcement	Jun-28	Network reinforcement in Witney 132kV	New
Mannington	Arnewood 132 kV and 33kV indoor switch rooms.	Jun-28	Addition of 3rd transformer and installing indoor switch rooms in Arnewood 132kV and 33kV	New
Melksham	Alderton Melksham Reinforcement	Jun-28	Replacing existing transformers and install new circuit between Yatton Keynall and Alderton.	New
Ealing	Bridge Road 66/11 kV reinforcement	Jun-28	Switchboard replacement at Bridge Road primary	New
Ealing	Copley Dene 66/11 kV reinforcement	Jun-28	Switchboard replacement at Copley Dene primary	New
Iver 66kV	Uxbridge 66/11 kV reinforcement	Jun-28	Replacing existing transformers at Uxbridge primary.	New
Axminster	Axminster - Yeovil 132kV cable replacement	Jun-28	Axminster - Yeovil 132kV oil filled cable replacement on 132kV circuit 2.	New
Nursling	Southampton Main/Reserve bsp 33kV reinforcement	Jun-28	Southampton Main/Reserve bsp 33kV indoor switchboard + new bsp 33kV indoor switchboard in Southampton	New
Nursling	New Southampton - Central Bridge 33kV circuit reinforcement	Jun-28	New Southampton - Central Bridge 33kV circuit reinforcement - Southampton 33kV	New
Nursling	Old Docks 33kV circuit overlay - Central Bridge primary	Jun-28	Central Bridge - Old Docks 33kV circuit overlay - Central Bridge primary	New

Minety	Cirencester - Minety Village 33kV circuit Reinforcement	Jun-28	Circuit reinforcement on Cirencester - Minety Village 33kV.	New
Iver 132kV	Slough - Slough South - Cippenham 132kV Network reinforcement	Jun-28	Reconfigure the 132kV network between Slough (23530 & 23531) and Cippenham (23525) and add a 3rd 132kV circuit between Iver 132kV (17613) and Slough South (23520) alongside a 3rd 132/33 kV transformer	No Change
Bramley	Thatcham - Ashford Hill 132kV circuit reinforcement	Jul-28	Install a new 132kV dual circuit from Ashford Hill tee point to Thatcham 132kV (24110) to maintain security of supply	No Change
Fleet	Alton-Fernhurst 132kV networks- New 132kV switching substation	Aug-28	A new 132kV switching substation with dedicated feeder breakers from/to Fleet (10314,10315), Alton(10310,10312), Fernhurst(15710,15711) and Winchester (25114) to supply Alton and Fernhurst substation from Nursling under second circuit outage conditions	No Change
Bramley	Thatcham 132/33 kV reinforcement	Oct-28	Install a new 132/33 kV 90MVA transformer at Thatcham	New
Cowley	Cowley Local 132kV network reinforcement	Nov-28	Network reinforcement in Cowley local 132kV	New
Iver 132kV	Beaconsfield 33kV Circuit and Transformer reinforcement	Mar-29	Dispose 4 transformers, install 2 dual-ratio 33/6.6 – 11 kV units and upgrade circuits to increase the substation firm capacity at Beaconsfield primary (91121, 91121, 91123)	No Change
Iver 66kV	North Hyde 66/22 kV switchgear replacement	Mar-29	Addition of a new 66kV switchboard at North Hyde GSP (1401, 1501)	No Change
Ealing	Harvard Lane 22/11 kV Transformers replacement	Jun-29	Dispose 3 transformers, install 2 new units to to increase the substation firm capacity at Harvard Lane primary (93111)	Completion date changed from Mar-29
Mannington	New 33kV board at Salisbury 33kV	Jun-29	Install new 33kV gis board at Salisbury 33kV	New

Mannington	Dual 33kV circuit from Salisbury 33kV to Neth 11kV	Jun-29	Install dual 33kV ccts from Salisbury 33kV to Neth primary.	New
Mannington	Dual 33kV circuit from Salisbury 33kV to Petersfinger 11kV	Jun-29	Install dual 33kV ccts from Salisbury 33kV to Petersfinger primary.	New
Lovedean	Emsworth 33/11 kV substation relocation +civil works	Sep-29	Build a new primary substation and relocate Emsworth primary.	New
Mannington	Reinforce circuit from Mannington 132kV to Christchurch 33kV	Sep-29	Install new underground cables from Mannington 132kV to Christchurch 33kV.	New
Cowley	Yarnton 33kV reinforcement	Dec-29	Reinforce network on Yarnton bsp	New
Nursling	New Southampton 33kV and dual 132kV cct from Nursling 132kV	Mar-30	New Southampton BSP and dual 132kV circuit from Nursling 132kV - Southampton 33kV	New
Lovedean	Bilsham primary reinforcement	Apr-30	Install a third transformer, new 33kV switchgear and 11kV switchgear reinforcement in Bilsham primary.	New
Mannington	Wimborne 33/11 kV Transformers replacement	Jun-30	Reinforcement of the existing transformers with higher rated assets to increase the substation firm capacity at Wimbourne primary (89227)	Mar-28
Lovedean	Birdham 33/11 kV Transformers replacement	Jun-30	Reinforcement of the existing transformers with higher rated assets to increase the substation firm capacity at Birdham primary (11650)	Completion date changed from Mar-30
Laleham	Egham 33/11 kV Transformers replacement	Jun-30	Install a new transformer to increase the substation firm capacity at Egham primary (86515)	Completion date changed from Mar-30
Melksham	Rowden -Melksham reinforcement	Jun-30	Upgrade two transformers in Rowden	New
Mannington	Addition of dual 132kV cct from Mann 132kV to Shaftesbury 33kV	Jul-30	Addition of dual 132kV cct from Mann 132kV to Shaftesbury 33kV	New

Fleet	Fleet Bramley split - 132kV network reinforcement	Jul-30	Two separate 132 kV bus will be established at Reading, two new 132kV cable circuits will be laid from Bramley to Burghfield, reinforcement of 132kV Fleet-Basingstoke Tee-Reading circuit 2 and replacement of 132kV switch disconnectors at Wokingham would be required.	New
Laleham	East Bedfont 132/33 kV Transformers replacement	Oct-30	Reinforcement of the existing transformers with higher rated assets to increase the substation firm capacity at East bedfont A BSP (14940)	Completion date changed from Mar-29
Bramley	Thatcham/Beenham 33kV Circuit Reinf	Jan-31	Reinforce cable section Thatcham – Beenham 33kV circuit and modify Protection Thatcham BSP (P)	New
Cowley	Osney 132kV Circuit and Transformer	Mar-31	Install a 3rd 132kV circuit between Cowley (14016) and Osney (20920) alongside a new 132/33kV transformer at Osney BSP to increase network capacity	Completion date changed from Mar-30
Cowley	Fulscot 33kV circuit reinforcement	Mar-31	Reinforce circuit between Drayton 33kV and Fulscot primary.	New
Lovedean	Chalcraft Lane New 11kV reinforcement	Apr-31	Build a new primary substation to accommodate some of the load growth at South Bersted primary.	New
Botley Wood	Netley Common 33kV circuit reinforcement	Jun-31	Install a new cct and a 33kV outdoor circuit breaker in Netley Common BSP/ 7 x 33kV indoor circuit breaker in Townhill Park primary.	New
Lovedean	Lovedean 3 new 132kV circuits to Wymering 33kV, transfer from Fort Widley primary/Lovedean 132kV	Jun-31	Install three new 132kV circuits to Wymering 33kV, transfer load from Fort Widley primary/ Lovedean 132kV.	New
Fleet	Coxmoor Wood 132/33 kV bsp load related reinforcement Coxmoor Wood 33kV / Coxw 3rd Transformer	Dec-31	Install a new transformer at Coxmoor Wood bsp.	New

Bramley	Bramley Thatcham Amesbury - 132kV Bramley/ load reinforcement	Dec-31	Install a new underground cable circuit from Bramley to Thatcham.	New
Cowley	Stokenchurch 33kV network reinforcement	Jan-32	Add 20.5km underground cable and 4x33kV circuit breakers (86103)	Completion date changed from Mar-26
Lovedean	Portsmouth 33kV circuit and transformer reinforcement	Jan-32	Install a third new grid transformer and a third 132kV circuit in Portsmouth 33kV.	New
Melksham	Ashton Park 33kV circuit reinforcement	Jul-32	Reutilise the redundant Norrington-Ashton Park 33kV circuit and reconnect the circuit to Norrington 33kV.	New
Laleham	Staines 132/33 kV reinforcement	Mar-33	Additional double busbar and an extra transformer at Staines.	New

Asset Replacement Projects

GSP	Name	Estimated Completion	Impact on Distribution Network Capability	Changes from previous LTDS
Laleham	Feltham - 6.6kV Switchgear Replacement	Complete	Increase Health Index	Oct-24
Bramley	Beenham - 33kV Switchgear Replacement	Complete	Increase Health Index	Oct-24
Lovedean	Shripney 33/0.433 kV Transformer Replacement	Dec-24	Increase Health Index	No Change
Cowley	Sutton Courtenay - 33kV Switchgear Replacement	Feb-25	Increase Health Index	Completion date changed from Aug-24
Mannington	Winfrith Heath - 11kV switchboard Replacement	Feb-25	Increase Health Index	Completion date changed from Nov-24
Mannington	Parkstone North 33/11 kV Transformer Replacement	Mar-25	Increase Health Index	Completion date changed from Aug-24
Melksham	Amesbury - Replace A1MTA and decommission A1MTB	Mar-25	Increase Health Index	No Change
Bramley (Basingstoke)	Basingstoke T1A & T2A - A2MT transformer replacement	Mar-25	Increase Health Index	No Change
Melksham	Chippenham - Sutton Benger 33kV circuit replacement	May-25	Remove maintenance restriction	Completion date changed from Mar-25

Nursling	Romsey - 11kV Switchboard Replacement	Jul-25	Increase Health Index	Completion date changed from Jul-24
Chickerell	Puddletown – 11kV Switchgear Replacement	Sep-25	Increase Health Index	Completion date changed from Sept-24
Lovedean	Fort Widley - Fareham 132kV Fluid Filled Cable Overlay	Sep-25	Increase Health Index	Completion date changed from Jan-25
Fawley	Lynes Common – Replace isolators	Sep-25	Increase Health Index	No Change
Mannington	Wimborne – 11kV switchboard Replacement	Nov-25	Increase Health Index	Completion date changed from Dec-24
Mannington	Shaftesbury 132kV Switchgear Replacement	Dec-25	Increase Health Index	Completion date changed from Jul-25
Bramley (Fleet)	Chobham - Transformer and 33kV switchgear replacement	Mar-26	Increase Health Index	No Change
Bramley (Thatcham)	Hungerford - Transformer and 33kV switchgear replacement	Mar-26	Increase Health Index	No Change
Minety	Lechlade - Transformer replacement	Mar-26	Increase Health Index	No Change
Bramley (Fleet)	Haslingbourne - Transformer and 33kV switchgear replacement	Mar-26	Increase Health Index	No Change
Fawley	Fawley North - 11kV Switchgear Replacement	Jun-26	Increase Health Index	No Change
Chickerell	Chickerell – 33kV Switchgear Replacement	Aug-26	Increase Health Index	No Change
Bramley (Fleet)	MVEE - Transformer and 33kV switchgear replacement	Aug-26	Increase Health Index	Completion date changed from Mar-26
Melksham	Chippenham – 33kV Switchgear Replacement	Jan-27	Increase Health Index	No Change
Chickerell	Cerne Abbas 33kV & 11kV Switchgear & 33/11 kV Transformer Replacement	Feb-27	Increase Health Index	Completion date changed from Oct-26
Mannington	Winterborne Kingston - Transformer Replacement	Mar-27	Increase Health Index	No Change
Mannington	Wareham - Transformer replacement	Mar-27	Increase Health Index	No Change
Mannington	Victoria Park - 33kV Switchgear Replacement	Mar-27	Increase Health Index	Completion date changed from Mar-26
Nursling	Southampton - Woodmill Lane - Regents Park 33kV Fluid Filled Cable Overlay	Jun-27	Increase Health Index	Completion date changed from Dec-26

Melksham	Frome - 33kV Switchgear Replacement	Jun-27	Increase Health Index	No Change
Nursling	Dunbridge - 11 & 33 kV Switchgear Replacement/Refurbishment	Aug-27	Increase Health Index	Completion date changed from Jul-26
North Hyde	Replacement of North Hyde - Osterley and North Hyde - Vicarage Farm Rd 66kV cables	Dec-27	Increase Health Index	Completion date changed from May-27
Mannington	Lytchett 33kV Switchgear replacement	Dec-27	Replace 33kV switchgear at Lytchett BSP (18930) to increase the fault level rating	No Change
Minety	Stratton - Transformer replacement	Feb-28	Increase Health Index	Completion date changed from Mar-27
Ealing	Ealing 22kV Switchgear replacement	Apr-28	Replace 66kV circuit breakers to increase the fault level rating at Ealing BSP (93015 & 93029)	No Change
Ealing	Ealing 66kV Switchgear replacement	Apr-28	Replace 66kV circuit breakers to increase the fault level rating at Ealing GSP (26758, 26759, 26760 & 26761)	No Change
Iver 132kV	Denham - Transformer Replacement	Mar-29	Increase Health Index	No Change

Assets Decommissioned

GSP	Name	Asset Type	From Bus	To Bus
Fleet	Aldershot	33kV Switchgear (various)	10130	Various
Mannington	Mannington - Mill Lane	33kV Switchgear (various)	89250	89202
Botley Wood	Netley Common	132/33 kV Transformer (A1MT & A2MT)	20210 & 20211	20230
Cowley	Cholsey	33/11 kV Transformer (C1MT & C2MT)	85901	85913
Lovedean	Havant	132/33 kV Transformer (A1MT & A2MT)	16910 & 16914	16930

Mannington	Stapleford	33/11 kV Transformer (C1MT & C2MT)	89311	89324
Nursling	Maybush	11kV Switchboard	88614	N/A
Bramley	Basingstoke	132/33 kV Transformer (A1MTA)	11218	11230
Nursling	St Cross	33/11 kV Transformer (C1MT & C2MT) & 11kV Switchboard	88505	88522
Iver	Grassingham Road	22/6.6 kV Transformer (D1MT, D2MT & D3MT) & 6.6kV Switchboard	91116, 9117 & 9118	91127 & 91128
Axminster	Sherborne	33/11 kV Transformer (C1MT & C2MT) & 33kV Switchboard	89909 & 89910	89926
Lovedean	Hoeford	33/11 kV Transformer (C2MT), 33kV Switchboard and 11kV Switchboard	87704	87725
Melksham	Andover	33kV Switchboard	10730	Various
Mannington	Wimborne St Giles	33kV Switchgear (C1H0)	89210	89228
Mannington	Verwood	33kV Switchgear (C2L5)	89203	89247
Mannington	Chippenham	33kV Switchgear (C2W0)	13431	13432

Cancelled Projects

GSP	Name	Estimated Completion	Impact on Distribution Network Capability	Changes from previous LTDS
Mannington	Bemerton 33kV Circuit and Transformer reinforcement	Cancelled	Increase capacity at Bemerton (89302)	Cancelled
Miney	Faringdon 33/11 kV Transformers replacement	Cancelled	Increase the capacity at Faringdon primary (85420)	Cancelled
Melksham	Alderton 33/11 kV Transformers replacement	Cancelled	Increase the capacity at Alderton primary (85118)	Cancelled
Bramley (Fleet)	Fernhurst - Midhurst 33kV Circuit reinforcement	Cancelled	Reinforce the 33kV circuit between Fernhurst (15730) and Midhurst (19850) to	Cancelled



			increase network capacity	
Axminster	Yeovil - Yetminster 33kV Circuit reinforcement	Cancelled	Reinforce the 33kV circuit between Yeovil (26430) and Yetminster (89901) to increase network capacity	Cancelled